




Criterion 4 - Infrastructure and Learning Resources



4.1 – Physical Facilities

4.1.1: Other Facilities: Fire Safety

Fire –Extinguishing System

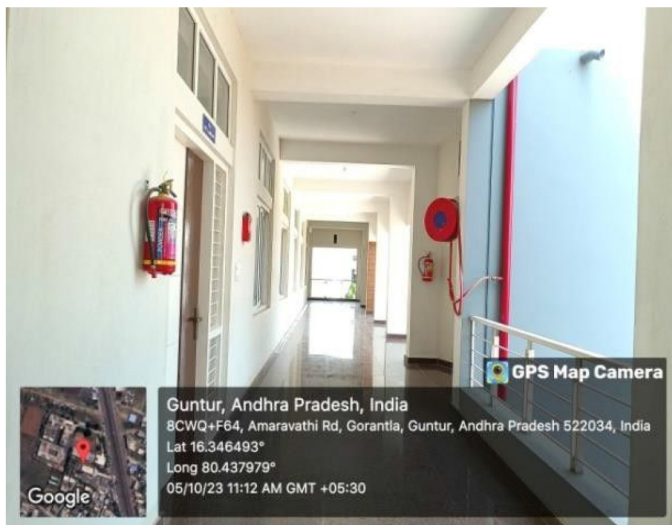

Fire Extinguisher at Gnanam Block

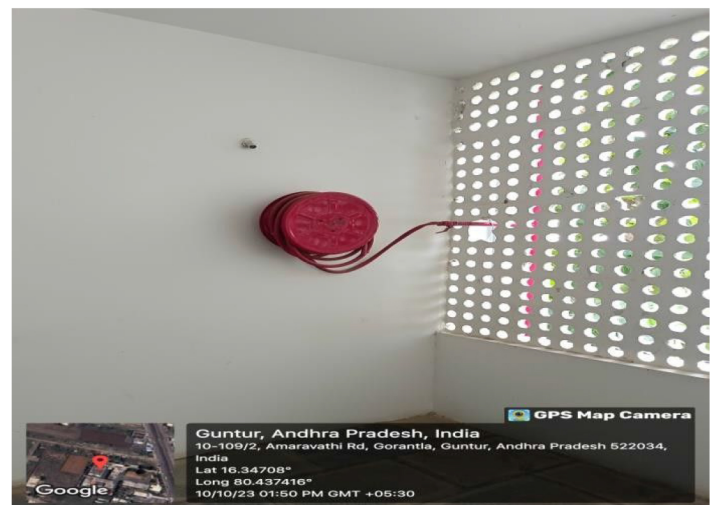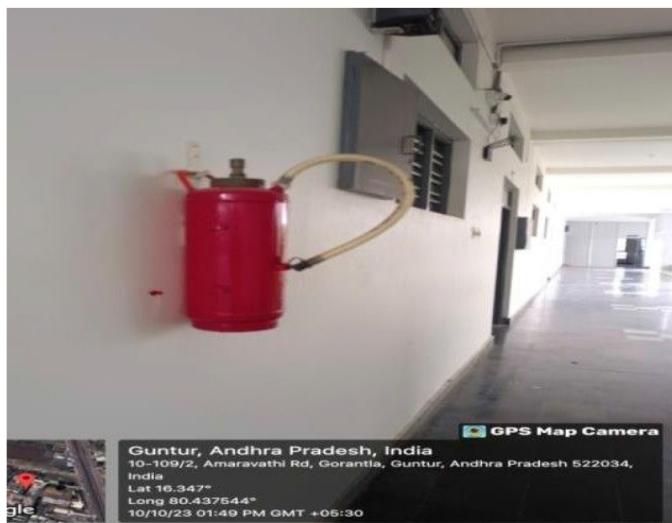

Fire Extinguisher at St. Anne Block



ST. ANN'S COLLEGE FOR WOMEN

(Affiliated to Acharya Nagarjuna University,
Recognized Under Section 2(f) of UGC Act 1956-New Delhi)
Amaravathi Road, Gorantla, Guntur – 522034 (A.P)


Email: st_anns_coll@yahoo.co.in Website: www.stannscollegeforwomen.org

Criterion: IV

Metric –4.1.1



Fire Extinguisher at Labs

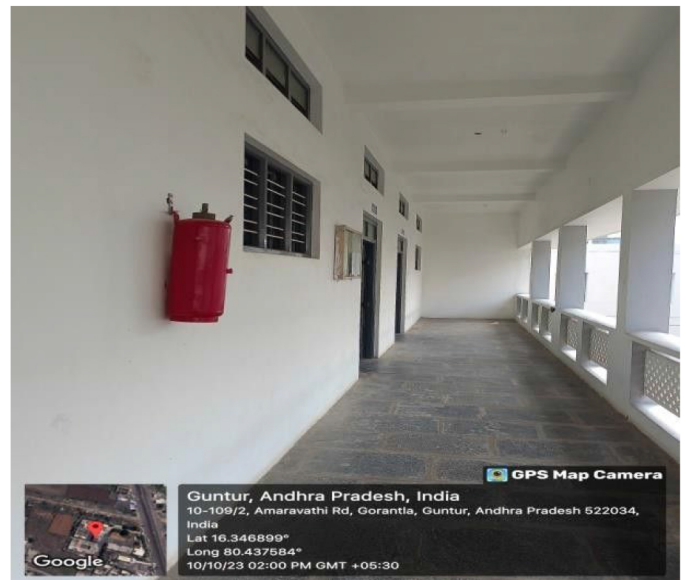

Fire extinguisher at Class Corridor



Fire Hydrant Valve



ST. ANN'S COLLEGE FOR WOMEN

(Affiliated to Acharya Nagarjuna University,
Recognized Under Section 2(f) of UGC Act 1956-New Delhi)
Amaravathi Road, Gorantla, Guntur – 522034 (A.P)


Email: st_anns_coll@yahoo.co.in Website: www.stannscollegeforwomen.org

Criterion: IV

Metric –4.1.1



Fire Extinguisher at Gnanam Block

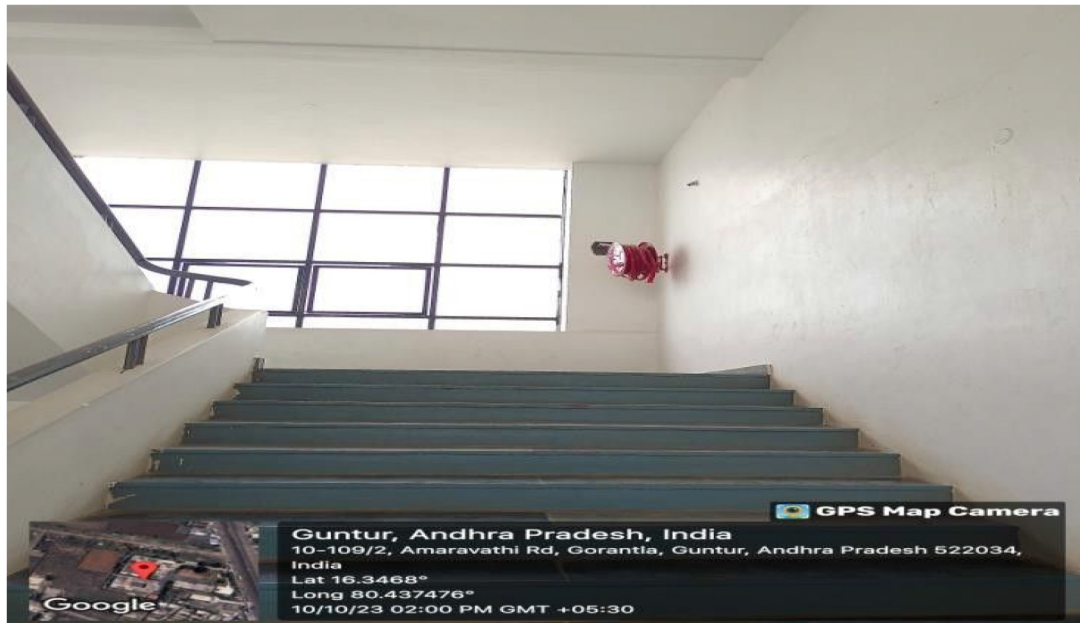

Government of Andhra Pradesh
A.P. State Disaster Response and Fire Services Department
Annual Periodical Renewal Fire Certificate

From:
 District Fire Officer
 Andhra Pradesh, Guntur

To:
 The Registrar,
 Acharya Nagarjuna University, Nagarjuna
 Nagar, Guntur

File No: 14230/GNT/DFO/2020, Date: 23/09/2020
Occupancy NoC RC Number: 3067/A2/2012

Sub: Andhra Pradesh State Disaster Response and Fire Services Department - Annual Periodical Fire Certificate to the constructed Non Multi Storeyed Building of M/s St. Ann's College for women, represented by Dr Sr. Fathima, D. No. 466 and 467, Amaravathi Road, Gorantla, Guntur City - Regarding.

- Ref:
1. G.O.Ms.NO.71 Home (Prisons-A) Department, Dated.01-04-2010 & G.O.Ms.NO.140 Home(Prison & Fire Services) Department, Dt.04-09-2015.
 2. This Office Delegation of Powers Rc.No.3350/Audit/NOC/2012, Dated.09-03-2017.
 3. This Office NOC for Occupancy Rc No. 3067/A2/2012, Dt.18/09/2012
 4. Renewal NOC For Occupancy 3067/A2/2012, Dt.28/09/2019
 5. Online Application for Renewal NOC of Dr Sr. Fathima, D. No. 466 and 467, Amaravathi Road, Gorantla, Guntur City - Inspection report called for Regarding.
 6. Online Inspection Report submitted by Officers of this Department on 23-09-2020.

<< 0 >>

The Management of M/s St. Ann's College for women, represented by Dr Sr. Fathima, D. No. 466 and 467, Amaravathi Road, Gorantla, Guntur City has requested to issue Annual Periodical Fire Certificate for period 2017-2018 duly remitting the Fire Precautionary fee for Rs.113350/- vide challan No. 41143306372020, Dated 15/09/2020 at SBI, ONLINE.

M/s St. Ann's College for women


1. This certificate is being issued as per G.O.Ms.No 140 Home (prisons & Fire Services) Department, Dt: 04.09.2015.
2. The No Objection Certificate for Occupancy was issued vide reference cited (3) and the Management has also obtained Annual Periodical Renewal Fire Certificate for vide reference 4th cited to the constructed Non Multi Storeyed Building.
3. The Officers of the department have recommended to issue The Annual Periodical Renewal Fire Certificate Dr Sr. Fathima D. No. 466 and 467, Amaravathi Road, Gorantla, Guntur City, subject to the following conditions.

Sl	As Builder	As Occupant	As Security Personnel
1	All the fire protection arrangements shall be maintained in good condition as seen during inspection.	All the escape/exit routes shall not be kept locked/blocked or encroached	All the occupants must know the correct method of operation of the fire fighting system installed.

2	Any loss of life or property due to non-functioning of fire safety measures and other installations shall be the responsibilities of the management.	All occupants shall be trained to operate the fire safety equipments during emergency.	Mock drills should be conducted once in 3 months for initial two years. Thereafter, once in every 6 months.
3	Addition / alteration, if any in the building may be verified by building authority.	Mock drills should be conducted once in 3 months for initial two years. Thereafter, once in every 6 months.	All security personnel shall be trained to operate the fire safety equipments during emergency.
4	This is Only for Fire Safety Point of View.	Raise the alarm if the fire cannot be controlled; Evacuate the area completely at once with nearest safe exit.	Attack the fire using available fire equipment only if you feel capable of controlling. If not, take all steps to isolate the area by closing doors and windows.

5. The Responsibility/liability of the owner/occupier or both to maintain Fire safety measures in good condition in all times, in accordance with AP Fire safety Act 1999 and Rules, 2006. The following deficiencies are identified by the officers of the department and needs to be attended to by the management.

1. This NOC is issued from fire safety point of view only basing on recommendation of the inspection committee, Guntur District. 2. This NOC is not for claiming proprietary or ownership rights. Further, in case of any deviation noticed with respect to this NOC after issuance of this NOC, the same NOC shall be liable for cancellation at any time

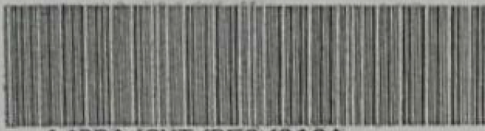

14230/GNT/DF0/2020

Your Sincerely,

V. S. Srinivasulu Reddy
23/9/20

District Fire Officer
Andhra Pradesh, Guntur

Copy to Management Dr Sr. Fathima, the Principal of M/s St. Ann's College for women, D. No. 466 and 467, Amaravathi Road, Gorantla, Guntur City
Copy to Assistant District Fire Officer Concerned
Copy to Station Fire Officer Concerned



D. S. Fathima
PRINCIPAL
St. Ann's College for Women
GORANTLA, GUNTUR